



## Exterior BSI-HC-FFP-14

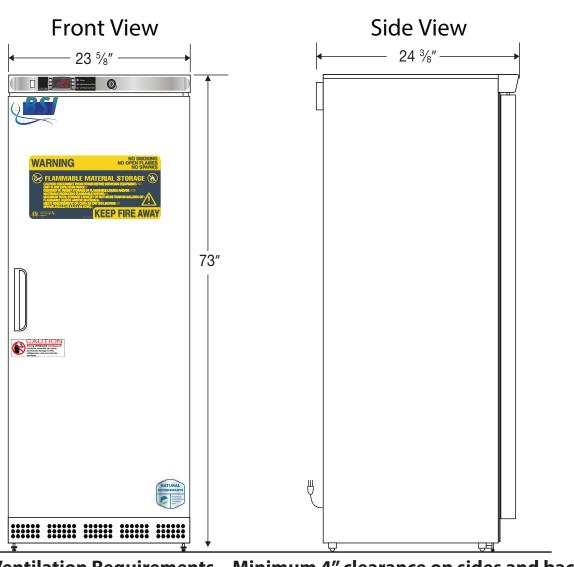

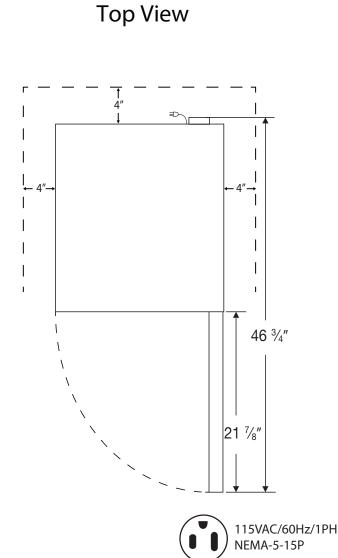

NOTE: Ventilation Requirements – Minimum 4" clearance on sides and back

Cu. Ft	Defrost	Door	Int Door	Shelves	W"	D"	H″	Refrigerant	H.P.	Amps	Weight
14	Manual	1 Solid	0	6 Fixed	23 %	24 %	73	R290	1/3	3.5	165 lbs.